



INSTRUCTIONS

GEH-230AA
Supersedes GEH-230Z

INSTRUMENT TRANSFORMERS BUTYL-MOLDED AND COMPOUND-FILLED, 600-V THROUGH 15-KV

INTRODUCTION

These instructions apply to indoor and outdoor instrument transformers of butyl-molded and other dry-type constructions. For information on the installation and care of transformers with unusual ratings of frequency, secondary voltage, current, or on installations where unusual conditions exist (refer to American Standards for Instrument Transformers, ASA C57.13-1954, section 13-00), consult the nearest sales office of the General Electric Company. When special information is requested, give the complete nameplate data in order to identify the transformer.

BEFORE INSTALLATION

INSPECTION

Before installation, transformers should be inspected for physical damage that may have occurred during shipment or handling. During shipping, transformers usually are supported only by the base or mounting supports, except that certain butyl-molded types may be shipped from the factory supported by butyl surfaces. Transformers should be dry and the surface of the bushings should be clean. All butyl surfaces should be considered the same as the surface of a porcelain bushing in regard to cleanliness and dryness.

DRYING OUT

Transformers that have been submerged in water should be dried out before installation. Wet asphalt-impregnated or varnish-impregnated transformers may be dried by self-heating. To do this, allow the transformer to stand not less than twelve hours in a room of constant temperature. Measure and record the room temperature and resistance of the secondary winding. Short-circuit the primary winding and apply a controllable voltage to the secondary winding. Adjust the voltage so that sufficient current will flow in the winding to raise its temperature to approximately 80 C. The rate of temperature rise should not exceed 6 C per half hour. The winding temperature should be held at approximately 80 C

until the transformer is dry. It will usually require 24 to 48 hours to dry a transformer.

The amount of current necessary to obtain a winding temperature of 80 C varies because of the differences in heat dissipation and current densities in the different types of transformers. It is advisable to start with a current not greater than two amperes in the secondary of a potential transformer, or not greater than five amperes in the secondary of a current transformer. Gradually increase this current until the proper heating is obtained. Increases of current should be made cautiously with frequent checking of the rise in temperature of the winding.

The temperature of the winding may be determined conveniently by the "resistance change" method. Since the resistance of a copper winding increases approximately 1 percent for each 2 1/2 C, the temperature rise may be calculated by measuring the "before" and "after" resistances and finding the percentage increase in resistance. For example, if the "after" resistance is 0.244 ohm and the resistance at the start (room) temperature is 0.200 ohm, the percentage increase is

$$\frac{0.244 - 0.200}{0.200} = 0.22 = 22\%$$

which corresponds to a temperature rise of 22 x 2 1/2 = 55 C (approximately). The approximate winding temperature at any time is the temperature rise at that time added to the ambient (room) temperature.

Butyl-Molded Transformers

Butyl-molded transformers, particularly designs for outdoor use, are relatively impervious to moisture. If, due to unusual circumstances, insulation tests indicate the possibility of the entrance of moisture into a butyl-molded transformer, refer to the nearest General Electric Apparatus Sales Office for detailed information on proper procedure.

TESTING

If it is desired to make insulation tests after the drying out period, or at any other time, these tests

These instructions do not purport to cover all details or variations in equipment nor to provide for every possible contingency to be met in connection with installation, operation or maintenance. Should further information be desired or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to the General Electric Company.

GEH-230AA Instrument Transformers

may be made in accordance with American Standards for Instrument Transformers, ASA C57.13-1954. (Note: Periodic field tests of insulation should not exceed 65 percent of the ASA test voltage. Incoming tests of new equipment should not exceed 75 percent of the ASA test voltage.)

Convenient methods for testing polarity are given in American Standards C-57.13, the Electrical Metermen's Handbook published by Edison Electric Institute, and General Electric publication GET-97.

For ratio and phase angle tests, refer to Electrical Metermen's Handbook and General Electric publications GET-97 and GET-1725.

Certificates

A certificate of test is supplied with many types of butyl-molded potential and current transformers. The certificate is in the form of a tag attached to each transformer. The tag shows the ASA accuracy classification of the transformer, the burden at which it has been tested, and the actual test results of ratio correction factor and phase angle. The tag is perforated and can be detached as a 3- by 5-in. card for filing.

INSTALLATION

SAFETY PRECAUTIONS

Always consider an instrument transformer as a part of the circuit to which it is connected, and do not touch the leads and terminals or other parts of the transformer unless they are known to be adequately grounded.

The butyl surface of transformers should be considered the same as the surface of a porcelain bushing, since a voltage stress exists across the entire butyl surface from terminals to grounded metal parts.

Do not open the secondary circuit of a current transformer while the transformer is energized. This precaution is advisable since current transformers may develop open-circuit secondary voltages which may be hazardous to personnel or injurious to the transformer or equipment connected in the secondary circuit.

Always ground the metallic cases and frames of instrument transformers. The secondaries should be grounded close to the transformers. However, when secondaries of transformers are interconnected, there should be only one grounded point in this circuit.

MOUNTING

Instrument transformers should be mounted so that connections can be made to the power or distribution lines in such a manner as to avoid placing appreciable strains upon the terminals of the transformers. For high-current transformer ratings, 2000 amperes and above, there may be some interference from the electric field of the return bus unless the bus centers are kept at a minimum distance of 15 inches apart; for ratings above 5000 amperes this distance should be not less than 24 inches. If this type transformer is used with more than one primary turn, the loop should be at least

24 inches in diameter. Make sure that the secondary leads are twisted closely together and carried out without passing through the field of the primary conductors. It is not necessary that the bus exactly fill the window, but the bus or buses should be centralized. For ratings of 1000 amperes or less these precautions are generally unnecessary.

CONNECTIONS

SECONDARY CONNECTIONS

The resistance of all primary and secondary connections should be kept as low as possible to prevent overheating at the contacts, and to prevent an increase in the secondary burden.

The resistance voltage drop of the secondary leads should be included in calculating the secondary volt-ampere burden carried by instrument transformers. The total burden should be kept within limits suited to the transformers used.

Short-circuiting Device

Many current transformers are provided with a device for short-circuiting the secondary terminals, and are normally shipped from the factory with this device in short-circuiting position. Check the position of the shorting device. It should be opened prior to energizing the primary circuit, but only if a suitable burden, such as an ammeter, wattmeter, watt-hour meter, relay, etc., is connected to the transformer secondary terminals. If no burden is available, leave the shorting device closed.

On some designs the secondary cover is interlocked with the secondary hardware, so that the lead openings in the cover will be 180 degrees from the usable position unless the short-circuiting device is open. The short-circuiting device should be replaced for safety before the burden is removed from the transformer secondary.

Multi-ratio current transformers with tapped secondary windings are partially or completely inoperative when any portion of the secondary winding is short-circuited. All short-circuiting devices must be in the open position for normal operation, so that no portion of the winding is short-circuited.

In contrast, on double-secondary or multiple-secondary current transformers the shorting device must be left closed on all unused windings. (Unused windings are those to which no suitable burden is attached.)

PRIMARY BY-PASS PROTECTION

Thyrite[®] primary by-pass protectors are recommended for the proper protection of current

transformers which are so located as to be exposed to the effect of surge currents. They are especially recommended for low primary-current ratings, as these ratings have a relatively high winding impedance.

Thyrite primary by-pass protectors consist of one or more Thyrite disks which are connected in parallel with the primary winding of the transformer. When high-frequency or steep-front voltage surges occur, the characteristic of the Thyrite is such that an appreciable part of the surge current is by-passed through the protector. A high-surge voltage, which might result in failure within the primary winding, is thus prevented from building up across the winding.

GROUNDING

Grounding of instrument transformers should be made in accordance with AIEE Standard No. 52, March, 1951, Application Guide for Grounding of Instrument Transformer Secondary Circuits and Cases.

POLARITY

In wiring instrument transformer circuits, it is necessary to maintain the correct polarity relation between the line and the devices connected to the secondaries. For this reason, the relative polarity of each winding of a transformer is indicated by a marker H_1 (or a white spot) on or near one primary terminal, and a marker X_1 (or a white spot) near one secondary terminal; and in some cases by white bushings. See Figure 1. Where taps are present, all terminals will be marked in order. The primary terminals will be H_1, H_2, H_3 , etc.; the secondary terminals X_1, X_2, X_3 , etc.; and the tertiary terminals, if present, Y_1, Y_2, Y_3 , etc. H_1 always indicates the same instantaneous polarity as X_1 and Y_1 .

When connection is made to a secondary terminal having a polarity marking similar to a given primary terminal, the polarity will be the same as if the primary service conductor itself were detached from

the transformer and connected directly to the secondary conductor. In other words, at the instant when the current is flowing toward the transformer in a primary lead of a certain polarity, current will tend to flow away from the transformer in the secondary lead of similar polarity.

When connecting instrument transformers with meters or instruments, refer to the Instructions furnished with the meters or instruments involved.

AMBIENT TEMPERATURE

All General Electric transformers are designed to operate at either or both the ambient temperatures, as indicated by the Company, at the standard rating or ratings for the corresponding ambient temperatures, provided the altitude does not exceed 3300 feet. Refer to American Standards for Instrument Transformers, ASA C57.13-1954, section 13-00. Generally, the allowable ambient temperatures and ratings are marked on the transformer nameplate.

FUSES

Potential-transformer primary fuses are intended to protect the supply system rather than the transformer, although proper fuses will afford partial protection to the transformer in a large number of cases.

The fuses on butyl-type transformers, rated at 0.6-kv through 2.5-kv insulation class, are provided with molded fuse enclosures which are secured to the transformer by the spring action of the fuse clips.

Each fuse and its enclosure may be removed as a unit from the transformer. The fuse is then removed through an opening in one end of the enclosure. A fiber fuse puller must be used, or other suitable protective measures taken, if the fuses are to be removed while the unit is energized.

When replacing the fuse and enclosure, be sure that the plastic insulating piece, fastened under the transformer fuse clip, is inserted between the end

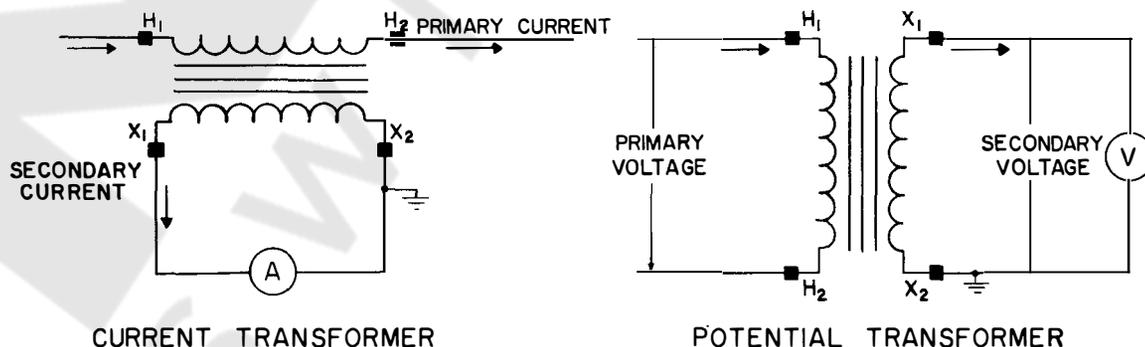


Fig. 1. Elementary Connections of Instrument Transformers

of the fuse and the open end of the fuse enclosure. Then press the enclosure firmly onto the transformer to seat the fuse into both clips.

The fuses of some dry-type transformers, 2400 volts and below, are supported by a hinged cover. If it is necessary to replace a fuse while the transformer is connected to an operating circuit, the cover should be opened by use of an insulating hook, which should be of sufficient length to prevent the operator from being burned in case a short circuit exists in the transformer.

In testing fuses for continuity of circuit, not more than 0.25 ampere should be used.

In replacing fuses, be certain that the voltage rating of the fuse is the one nearest above the line-to-line voltage of the circuit, regardless of the rated voltage of the transformer. Do not use fuses of higher voltage ratings, as undesirable overvoltages may result should the fuse blow. One permissible exception to this general rule is the use of Size A, Type EJ-1 fuse in the Types JE-2 and JVM-2 transformers. In this case the Size A fuse can be used on either 2400-volt, delta circuits or 2400/4160-volt, solidly grounded Y circuits.

MAINTENANCE

After instrument transformers for indoor use have been installed, they should need no care other than keeping them clean and dry. Transformers for outdoor installations should receive the same care in operation as power transformers of similar design and of similar voltage rating.

CLEANING BUSHINGS

Porcelain bushings may be cleaned by means of a wet cloth or by use of carbon tetrachloride* or ammonia. After cleaning a bushing, wash thoroughly with clean water to remove foreign material from the surface.

Butyl-molded transformers may be cleaned by scrubbing the butyl surface with detergent and a stiff brush to remove accumulated dirt or oil film. Remove the detergent by washing with clean water. Then apply a light grade of silicone oil (G-E Silicone Liquid, SF-92 or equal) to the butyl surface.

DEMAGNETIZING

If by accident a current transformer becomes magnetized, it should be demagnetized before being used for precision work. Connect at least 50 ohms resistance in series with the meters or instruments in the secondary circuit. Bring the primary current up to as near full load as possible and gradually reduce the series resistance until it reaches zero,

* Precautions against toxic vapors should be taken when using carbon tetrachloride.

being careful not to open the secondary circuit in the process. For best results, gradually reduce the primary current to zero before disconnecting the resistance circuit. The variable series resistor must have reliable contacts and be suitable for the thermal duty required.

Demagnetizing JAR-O Auxiliary Transformers

Due to the wide range of current ratios available in the Type JAR-O current transformer and the lack of standards for demagnetizing the odd ratios available, the following method is necessary to prevent voltages which are damaging to the transformer. See Fig. 2.

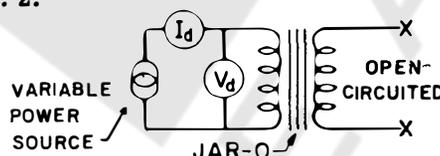


Fig. 2. Schematic diagram for demagnetizing JAR-O transformers

Key to Fig. 2.

I_d = ammeter for reading demagnetizing current.

V_d = voltmeter for reading demagnetizing voltage.

The I_d reading shall not exceed:

$$\frac{\text{Rated current of the winding energized}}{50}$$

The V_d reading shall not exceed:

$$\frac{160}{\text{Rated current of the winding energized}}$$

For example, for demagnetizing any 5-ampere JAR-O winding, do not exceed 32 volts and 0.1 ampere. The core will be adequately demagnetized when either the voltage or the current is increased to over 80% of the maximum value shown in the applicable formula (see above), and then gradually reduced to zero.

CAUTION: ONE OR MORE WINDINGS ARE OPEN-CIRCUITED DURING THIS OPERATION. THESE WINDINGS MAY DEVELOP VOLTAGES WHICH ARE HAZARDOUS TO PERSONNEL. OBSERVE SAFETY PRECAUTIONS.

DIFFERENTIAL PROTECTION

Standard General Electric current transformers may be used for differential protection through a considerable range of burden and overcurrent. The range is limited by the difference in burden, the maximum overcurrent, and the mechanical and thermal short-time rating. Information regarding these points may be obtained from the G-E publication GET-97 or from the nearest sales office of the company.

GENERAL ELECTRIC SALES OFFICE

GEZ-2500M

READY TO ASSIST YOU . . . When You Have Electrical Problems . . . Need Further Information . . . Require Ordering Instructions

KEY TO SALES OPERATIONS
C—Components Sales
I—Industrial Sales
M—Marine & Defense Facilities Sales
U—Electric Utility Sales

ALABAMA
 C I U Birmingham 35205...2151 Highland Ave.
 I Mobile 36602...704 Government St.
 I Montgomery 36105...25 S. Haardt Dr.

ARIZONA
 C I U Phoenix 85012...3550 N. Central Ave.
 I U Tucson 85716...151 S. Tucson Blvd.

ARKANSAS
 C I N. Little Rock 72114...1900 E. Washington
 U Pine Bluff 71602...P.O. Box 1033

CALIFORNIA
 C Burlingame 94010...1675 Rollins Rd.
 I Emeryville 94608...5000 Shellmound St.
 I Fresno 93728...1532 N. West Ave.
 C Los Angeles 90015...1543 W. Olympic Blvd.
 I M U Las Angeles 90012...212 N. Vignes St.
 I U Sacramento 95816...2407 "J" St.
 I M U San Diego 92103...2560 First Ave.
 I M U San Francisco 94104...235 Montgomery St.
 I Santa Clara 95050...1400 Coleman Ave.

COLORADO
 C I U Denver 80206...201 University Blvd.

CONNECTICUT
 I U Hamden 06514...2905 Dixwell Ave.
 C I U Hartford 06105...764 Asylum Ave.

DISTRICT OF COLUMBIA
 I M U Washington 20005...777-14th St., N.W.

FLORIDA
 I M Cocoa Beach 32931...1325 N. Atlantic Ave.
 I Coral Gables 33146...250 Bird Rd.
 I Jacksonville 32207...4040 Woodcock Dr.
 U Miami 33134...4100 W. Flagler St.
 I Orlando 32801...211 E. Robinson St.
 U Pensacola 32503...First Bank Bldg.
 C I U Tampa 33609...2106 S. Lois Ave.

GEORGIA
 C I U Atlanta 30309...1860 Peachtree Rd. N.W.
 I Macon 31201...682 Cherry St.
 I U Savannah 31405...5002 Paulsen St.

HAWAII
 I Honolulu 96801...American Factors, Ltd.
 P.O. Box 3230

IDAHO
 I U Boise 83701...1524 Idaho St.

ILLINOIS
 C I M U Chicago 60680...840 S. Canal St.
 I U Peoria 61603...2008 N.E. Perry Ave.
 I Rockford 61108...4223 E. State St.
 U Springfield 62701...607 E. Adams St.

INDIANA
 C I U Evansville 47714...2709 Washington Ave.
 C Fort Wayne 46804...1635 Broadway
 I U Fort Wayne 46807...3606 S. Calhoun St.
 C I U Indianapolis 46207...3750 N. Meridian St.
 C I South Bend 46601...430 N. Michigan St.

IOWA
 U Cedar Rapids 52401...210 Second St., S.E.
 C I Davenport
 (1039 State St., Bettendorf 52722)
 I U Des Moines 50310...3839 Merle Hay Rd.
 U Sioux City 51101...520 Pierce St.

KANSAS
 C Overland Park 66204...7219 Metcalf St.
 I U Wichita 67211...820 E. Indianapolis Ave.

KENTUCKY
 I U Lexington 40508...465 E. High St.
 C I U Louisville 40218...2300 Meadow Dr.

LOUISIANA
 I U Alexandria 71302...2001 MacArthur Dr.
 I Baton Rouge 70815...633 Oak Villa Blvd.
 I Lake Charles 70601...1424 Ryan St.
 I New Orleans 70125...4747 Earhart Blvd.
 M U New Orleans 70112...837 Gravier St.
 I U Shreveport 71101...400 Travis St.
 I West Monroe 71291...500 Natchitoches St.

MAINE
 U Augusta 04330...152 State St.
 U Bangor 04402...777 Central St.

MARYLAND
 C I U Baltimore 21201...1 N. Charles St.
 U Hagerstown 21740...49 E. Franklin St.
 U Salisbury 21801...P.O. Box 424

MASSACHUSETTS
 C I M U Boston 02117...31 St. James Ave.
 I Springfield 01103...120 Maple St.
 I Worcester 01605...288 Grove St.

MICHIGAN
 C I U Detroit 48202...700 Antoinette St.
 I Flint 48503...316 1/2 W. Court St.
 C I Grand Rapids 49508
 I 2821 Madison Ave., S.E.
 I U Jackson 49201...210 W. Franklin St.
 I Kalamazoo 49003...927 S. Burdick St.
 I Saginaw 48607...2nd National Bank Bldg.

MINNESOTA
 U Duluth 55802...14 W. Superior St.
 U Fergus Falls 56537...106 E. Washington St.
 C Minneapolis 55424...4018 W. 65th St.
 I U Minneapolis 55402...12 S. Sixth St.

MISSISSIPPI
 U Gulfport 39502...P.O. Box 33
 I Jackson 39206...33 North Mart Plaza
 I Jackson 39201...210 S. Lamar St.

MISSOURI
 I Joplin 64801...310 Wall St.
 I U Kansas City 64105...106 W. 14th St.
 C I U St. Louis 63101...1015 Locust St.

MONTANA
 I Billings 59101...303 N. Broadway
 I U Butte 59701...103 N. Wyoming St.

NEBRASKA
 I U Omaha 68102...409 S. 17th St.

NEVADA
 U Las Vegas 89105...1711 S. 8th St.

NEW HAMPSHIRE
 U Manchester 03104...46 Bay St.

NEW JERSEY
 C I U East Orange 07017...26 Washington St.

NEW MEXICO
 I U Albuquerque 87108...120 Madeira Dr. N.E.

NEW YORK
 I M U Albany 12206...8 Colvin Ave.
 I M U Binghamton 13902...40 Frant St.
 C I U Buffalo 14202...625 Delaware Ave.
 I Elmira 14901...100 Woodlawn Ave.
 I M U New York 10022...641 Lexington Ave.
 C Rochester 14618...890 Winton Rd.
 I U Rochester 14604...339 East Ave.
 C Syracuse 13206...2360 James St.
 I U Syracuse 13206...3532 James St.
 C Waverly 14892...P.O. Box 308

NORTH CAROLINA
 C I U Charlotte 28202...129 W. Trade St.
 I Greensboro 27405...801 Summit Ave.
 I U Raleigh 27603...120 N. Boylan Ave.

NORTH DAKOTA
 U Bismarck 58501...418 Rosser Ave.

OHIO
 I U Akron 44313...2858 W. Market St.
 I U Akron 44313 (Agency & Distributor)
 ...2855 W. Market St.
 I U Canton 44703...515 Third St., N.W.
 C I U Cincinnati 45206...2621 Victory Pkwy.

C Cleveland 44116...20950 Center Ridge Rd.
 I M U Cleveland 44114...1020 Lakeside Ave.
 I Columbus 43212...395 E. Broad St.
 I U Columbus 43215...11 W. Monument Ave.
 C Dayton 45402...3430 S. Dixie Hwy.
 C Dayton 45439...166 Park Ave., W.
 C Mansfield 44902...3125 Douglas Rd.
 C I U Toledo 43606...400 E. Indianola Ave.
 U Youngstown 44507...272 E. Indianola Ave.

OKLAHOMA
 I U Oklahoma City 73106...2000 Classen Blvd.
 I Tulsa 74114...2651 E. 21st St.
 U Tulsa 74103...420 S. Main

OREGON
 I U Eugene 97401...1170 Pearl St.
 I Medford 97501...107 E. Main St.
 C I U Portland 97210...2929 N.W. 29th Ave.

PENNSYLVANIA
 I U Allentown 18102...732 N. 16th St.
 I Erie 16501...1001 State St.
 I U Johnstown 15092...841 Oak St.
 C Philadelphia 19124...1020 E. Erie Ave.
 I M U Philadelphia 19102...3 Penn Center Plaza
 C Pittsburgh 15234...300 At. Lebanon Blvd.
 I U Pittsburgh 15222...Oliver Bldg., Mellon Sq.
 C I York 17403...56 N. Harrison St.

RHODE ISLAND
 I Providence 02904...1006 Charles St., N.

SOUTH CAROLINA
 I U Columbia 29205...2728 Devine St.
 U Greenville 29607...1403 Laurens Rd.

TENNESSEE
 C I U Chattanooga 37402...832 Georgia Ave.
 I Kingsport 37664...1170 N. Eastman Rd.
 I U Knoxville 37921...1301 Hannah Ave., N.W.
 I U Memphis 38104...1420 Union Ave.
 C I U Nashville 37203...1717 West End Ave.
 M Oak Ridge 37830...253 Main St., East

TEXAS
 U Abilene 79601...442 Cedar St.
 U Amarillo 79101...303 Polk St.
 I U Beaumont 77701...1385 Calder Ave.
 C U Corpus Christi 78401...205 N. Chaparral St.
 I U Dallas 75247...8101 Stemmons Freeway
 I U El Paso 79901...215 N. Stanton St.
 I U Fort Worth 76102...408 W. 7th St.
 C I M U Houston 77027...4219 Richmond Ave.
 I Lubbock 79404...500 E. 50th St.
 I Midland 79704...122 N. "N" St.
 I U San Antonio 78204...419 S. Main Ave.

UTAH
 I U Salt Lake City 84101...431 S. Third E St.

VERMONT
 U Rutland 05702...38 1/2 Center St.

VIRGINIA
 I M Newport News 23601...311 Main St.
 I U Richmond 23230...1508 Willow Lane Dr.
 I U Roanoke 24016...920 S. Jefferson St.

WASHINGTON
 U Pasco 99301...824 W. Lewis St.
 I M U Seattle 98188...112 Andover Park, E.
 I U Spokane 99220...E. 1805 Trent St.

WEST VIRGINIA
 I Charleston 25328
 ...306 MacCorkle Ave., S.E.
 I U Fairmont 26555...310 Jacobs Bldg.
 I Huntington 25701...1401 Sixth Ave.
 I Wheeling 26002...40 14th St.

WISCONSIN
 I U Appleton 54912...510 W. College Ave.
 U Madison 53703...340 W. Washington Ave.
 C Milwaukee 53218...4701 N. 76th St.
 I U Milwaukee 53202...615 E. Michigan St.

CANADA
 Canadian General Electric Company, Ltd., Toronto

GENERAL ELECTRIC SERVICE SHOPS

WHEN YOU NEED SERVICE . . . These G-E service shops will repair, recondition, and rebuild your electric apparatus. The facilities are available day and night, seven days a week, for work in the shops or on your premises. Latest factory methods and genuine G-E renewal parts

are used to maintain peak performance of your equipment. For full information about these services, contact your nearest service shop or sales office.

ALABAMA
 Birmingham 35211...1500 Mims Ave., S.W.

ARIZONA
 (Phoenix) Glendale 85301
 ...4911 West Colter St.

CALIFORNIA
 Los Angeles 90001...6900 Stanford Ave.
 Oakland 94608...3400 Wood St.
 Sacramento 95814...99 North 17th St.
 San Francisco 94103...1098 Harrison St.

COLORADO
 Denver 80205...3353 Larimer St.

CONNECTICUT
 (Southington) Plantsville 06479
 ...370 Atwater St.

FLORIDA
 Jacksonville 32203...2020 W. Beaver St.
 (Miami) Hialeah 33010...1062 E. 28th St.
 Tampa 33601...P.O. Box 1245

GEORGIA
 (Atlanta) Chamblee 30005
 ...5035 Peachtree Industrial Blvd.

ILLINOIS
 Chicago 60632...4360 W. 47th St.

INDIANA
 Ft. Wayne 46803...1731 Edsall Ave.
 Indianapolis 46222...1740 W. Vermont St.

IOWA
 (Davenport) Bettendorf 52722
 ...1025 State St.

KENTUCKY
 Louisville 40209...3900 Crittenden Drive

LOUISIANA
 New Orleans 70114...1115 De Armas St.

MARYLAND
 Baltimore 21230...920 E. Fort Ave.

MASSACHUSETTS
 (Boston) Medford 02155
 ...3960 Mystic Valley Parkway

MICHIGAN
 Detroit 48202...5950 Third St.
 Flint 48505...1506 E. Carpenter Rd.

MINNESOTA
 Minneapolis 55430...2025-49th Ave., N.

MISSOURI
 Kansas City 64120...3525 Gardner Ave.
 St. Louis 63110...1115 East Road

NEW YORK
 Albany 12205...1097 Central Ave.
 Buffalo 14211...318 Urban St.
 North Bergen, N. J. 07047
 ...6001 Tonnelle Ave.
 Schenectady 12305
 (Instrumentation Service) I River Road
 Syracuse 13208...1015 E. Hiawatha Blvd.

NORTH CAROLINA
 Charlotte 28208...2328 Thrift Road

OHIO
 Cincinnati 45202...444 W. Third St.

Cleveland 44125...4477 East 49th St.
 Columbus 43223...2128 Eakin Rd.
 Toledo 43605...405 Dearborn Ave.
 Youngstown 44507...272 E. Indianola Ave.

OREGON
 Portland 97210...2727 N.W. 29th Ave.

PENNSYLVANIA
 Allentown 18103...668 E. Highland St.
 Johnstown 15902...841 Oak St.
 Philadelphia 19124...1040 E. Erie Ave.
 (Pittsburgh) West Mifflin, Pa. 15122
 ...4930 Buttermilk Hollow Rd., R.D. #1
 York 17403...54 N. Harrison St.

TEXAS
 Corpus Christi 78401...115 Waco St.
 Dallas 75235...3202 Manor Way
 Houston 77020...5534 Harvey Wilson Dr.
 Midland 79704...704 S. Johnston St.

UTAH
 Salt Lake City 84110...301 S. 7th West St.

VIRGINIA
 Richmond 23224...1403 Ingram Ave.
 Roanoke 24007...115 Albermarle Ave., S.E.

WASHINGTON
 Seattle 98134...3422 First Ave., S.
 Spokane 99211...E. 4323 Mission St.

WEST VIRGINIA
 Charleston 25328
 ...306 MacCorkle Ave., S.E.

WISCONSIN
 Appleton 54910...P.O. Box 83
 Menasha, Wis...664 Valley Rd.
 Milwaukee 53207...235 W. Oklahoma Ave.

NATIONAL SWITCHGEAR™